



## WaStop® Inline Check Valve Technical Specification PVC


<b>Model no.:</b>	WS75PVC-S3	WS75PVC-S4	WS75PVC-S5
<b>Nominal Size:</b>	80 mm		
<b>Pipe:</b>	PVC		
<b>Membrane:</b>	Silicone		
<b>Fasteners:</b>	Marine grade stainless steel (AISI 316)		

Technical data:	Soft (S2)	Standard (S3)	Hard (S4)
Max. back pressure*:	3 mH <sub>2</sub> O	5 mH <sub>2</sub> O	8 mH <sub>2</sub> O
Horizontal opening pressure*:	174 mmH <sub>2</sub> O	188** mmH <sub>2</sub> O	211** mmH <sub>2</sub> O
Horizontal closing pressure*:	76 mmH <sub>2</sub> O	72** mmH <sub>2</sub> O	81** mmH <sub>2</sub> O
Submerged opening pressure*:	130** mmH <sub>2</sub> O	187** mmH <sub>2</sub> O	210** mmH <sub>2</sub> O
Submerged closing pressure*:	15** mmH <sub>2</sub> O	36** mmH <sub>2</sub> O	210** mmH <sub>2</sub> O
Vertical opening pressure*:	201 mmH <sub>2</sub> O	223** mmH <sub>2</sub> O	245** mmH <sub>2</sub> O
Vertical closing pressure*:	94** mmH <sub>2</sub> O	104** mmH <sub>2</sub> O	115** mmH <sub>2</sub> O

\*) +/- 15% \*\*) Modeled value  
 - Values measured from bottom of pipe.  
 - Tests performed at room temperature (16-20°C).

Max Flow	m/s	l/s
	2	10

- Higher flows requires custom valve, contact Wapro  
 - Flange installation is highly recommended at flows above 2 m/s

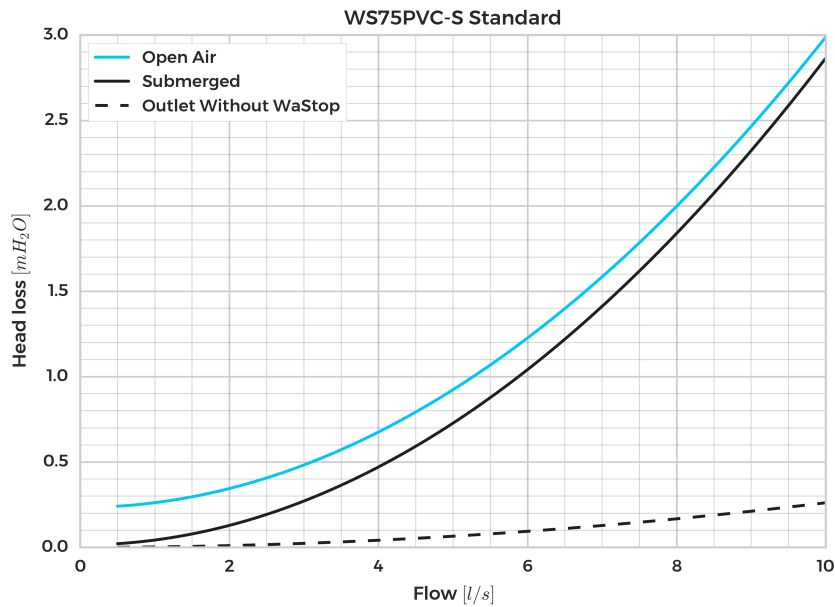

In the submerged case opening pressure [mmH<sub>2</sub>O /inH<sub>2</sub>O] is the difference between the water level upstream and the water level downstream and in the open-air case to the invert of the pipe. In vertical applications, the vertical opening pressure is measured from the outlet of the WaStop.

Postal address  
 Wapro AB  
 Munkahusvägen 103  
 SE-374 31 Karlshamn  
 SWEDEN

Tel: +46 454 185 10  
 Fax: +46 454 123 38  
 email: wapro@wapro.se  
 Website: www.wapro.se

Reg.nr: 556352-1466  
 Registered office:  
 Karlshamn, Sweden  
 VAT nr: SE 556 352 146604

HOLDING BACK  
THE FLOOD